

Instruction Manual | Bedienungsanleitung | Manual de instrucciones | Manuale d'istruzioni | Manuel d'instructions | Handleiding | Návod k použití



A1



3 PCS


A2





3 PCS

RETROFIT INSTALLATION

* Factory default setting: 4000K






OFF

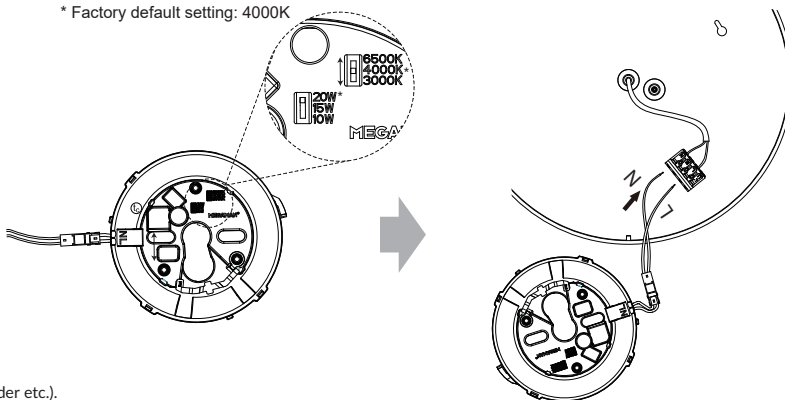

If necessary, remove the existing components from the existing luminaire (lamp holder etc.).

Metal

Plastic

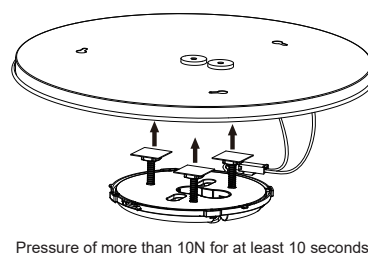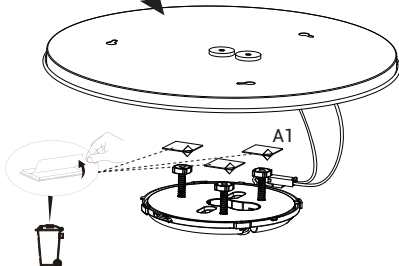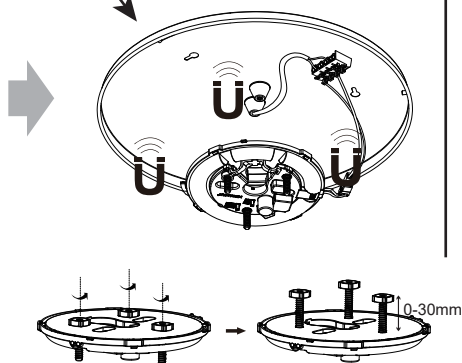


Pressure of more than 10N for at least 10 seconds





WARNING

- Ensure that the contact surface for attaching the adhesive metal tag (A1) is flat and smooth, without any dust or grease.
- After installation, wait for at least 3 hours before long-term use.

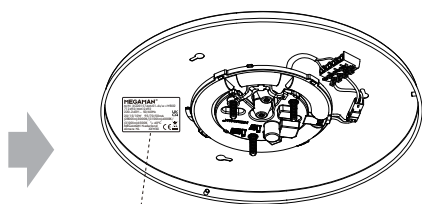


Replacement module rating label

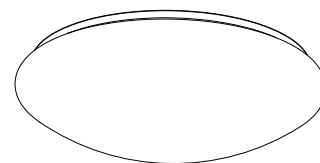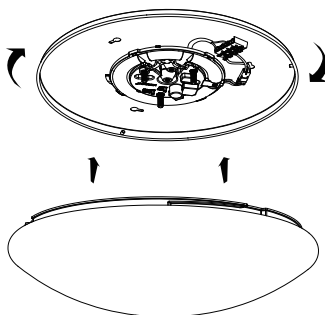






Replace light source of MEGAMAN® RENZO XChange / FONDA XChange

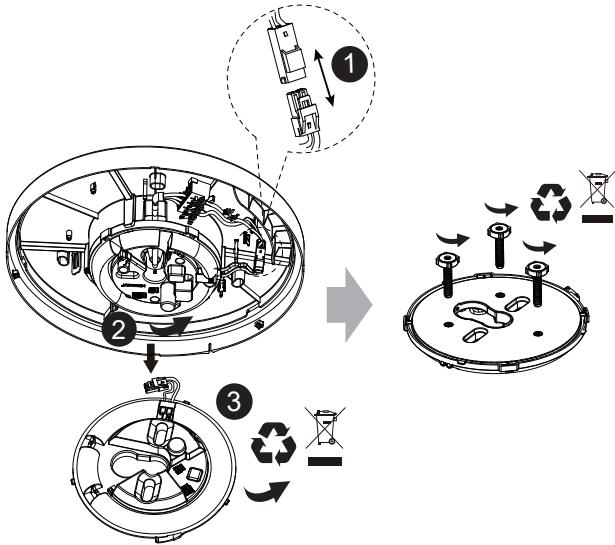

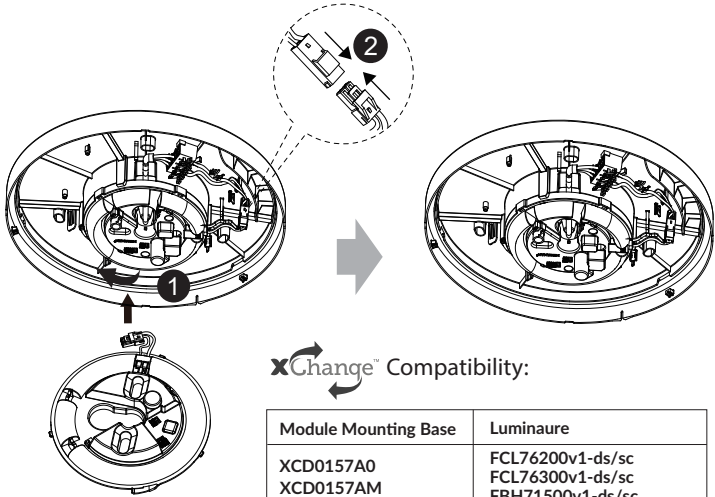

xChange™ Compatibility:

Module Mounting Base	Luminaire
XCD0157A0	FCL76200v1-ds/sc
XCD0157AM	FCL76300v1-ds/sc
	FBH71500v1-ds/sc

Warning : The insulation type between active parts of LED module and the mounting surface of the LED module is reinforced insulation based on 250 V~.

	P	I	Inrush Current	Inrush Duration	Max.no.of Luminaire Connection on MCB				 Ø(mm) H(mm)
			A	µs	B10	B16	C10	C16	
XCD0157AMv01-ds/sc+WB02 712492/MM12492	10/15/20W*	50/70/95mA	5.12	21.6	46	46	46	51	Ø157 x 39.5

*Factory default setting

DC Input
Compatible
180-260V

AC220
-240V

50/60
Hz

λ
>0.9

IP20

t_c
85°C

t_a
-30°C ~ +40°C





UK
CA

CE



MEGAMAN®